

Sustainability and Health are Integral Goals for the Built Environment
Healthy Buildings 2006
Lisbon, Portugal
June 4-8, 2006

Vivian Loftness, FAIA; Volker Hartkopf, PhD; Lam Khee Poh, PhD
PhD students: Megan Snyder, Ying Hua, Yun Gu, Joonho Choi, Xiaodi Yang
Carnegie Mellon University Center for Building Performance

Abstract

The importance of proving that sustainable design and engineering improves health, productivity, and quality of life has never been more important. To this end, the Center for Building Performance and Diagnostics (CBPD) at Carnegie Mellon University, in collaboration with the Advanced Building Systems Integration Consortium*, have been actively developing sustainable design guidelines and a database of laboratory, field, and simulation case studies that reveal the substantial environmental, health and productivity benefits of a range of advanced and innovative building systems. Captured in the Building Investment Decision Support tool (BIDS™), the cost-benefits of investing in a better built environment should drive measurable changes in building design, construction and management. This presentation will explore the health-related benefits of high performance buildings - designed to deliver the highest quality air, thermal control, light, ergonomics, privacy and interaction, as well as access to the natural environment.

Keywords: Sustainability and Health, Sustainable Design for Health, Healthy Building Systems

Definitions of sustainability

Many decisionmakers assume that sustainable design is about resource conservation – energy, water, and material resources. The last ten years, however, has seen a dramatic broadening of the definition of sustainability to include assurances for mobility and access as affected by land use and transportation, for health and productivity as affected by indoor environmental quality, and for the protection of regional strengths as we pursue a more globally shared quality of life. In the US, this broader definition of sustainability is most often ensured through the voluntary LEED™ (Leadership in Energy and Environmental Design) standard of the US Green Building Council. The 69 credits in the LEED for New Construction standard extend beyond the conservation goals of energy, water and materials to include sustainable sites and transportation, outdoor atmosphere, indoor environmental quality and waste.

The Center for Building Performance and Diagnostics at Carnegie Mellon University would argue for expanding this definition even further, to give greater emphasis to contextual and regional design goals, to natural conditioning, and to flexible infrastructures that support change and deconstruction.

* ABSIC members 2000 to present: Armstrong World Industries, BP Solar, Carnegie Mellon University, US Department of Energy, US Department of Defense, Electricité de France, US Environmental Protection Agency, Gale Foundation, US General Services Administration, Northwest Energy Efficiency Alliance, Public Works and Government Services Canada, Somfy, Siemens Energy and Automation, Inc., Steelcase Inc., Teknion Inc., Tyco Electronics, United Technologies/ Carrier, National Science Foundation.

Seven CBPD Principles for the Design of Sustainable Built Environments

1. Sustainable design depends on an integrative, human-ecological design approach.
2. Sustainable design depends on changing approaches to land-use and community fabric.
3. Sustainable design depends on the effective use of natural, local and global resources to reduce infrastructure loading and maximize infrastructure use.
4. Sustainable design depends on the design of flexible, plug and play systems.
5. Sustainable design depends on the use of sustainable materials and assemblies.
6. Sustainable design depends on design for life-cycle instead of first cost.
7. Sustainable design depends on the promotion of infrastructures to neighborhood amenities.

The CBPD defines sustainable design as “a transdisciplinary, collective design process driven to ensure that the built environment achieves greater levels of ecological balance in new and retrofit construction, towards the long term viability and humanization of architecture. Focusing on environmental context, sustainable design merges the natural, minimum resource conditioning solutions of the past (daylight, solar heat and natural ventilation) with the innovative technologies of the present, into an integrated "intelligent" system that supports individual control with expert negotiation for environmental quality and resource consciousness. Sustainable design rediscovers the social, environmental and technical values of pedestrian, mixed-use communities, fully using existing infrastructures, including "main streets" and small town planning principles, and recapturing indoor-outdoor relationships. Sustainable design avoids the further thinning out of land use, and the dislocated placement of buildings and functions caused by single use zoning. Sustainable design introduces benign, non-polluting materials and assemblies with lower embodied and operating energy requirements, and higher durability and recyclability. Finally, sustainable design offers architecture of long term value through 'forgiving' and modifiable building systems, through life-cycle instead of least-cost investments, and through timeless delight and craftsmanship” [1].

The clarity of the definition of sustainability matters, especially when assessing the relevance of sustainable design, construction, and operations of buildings to long term human and environmental health.

A Definition of Health to be Integral with Sustainable Design

Building on the Cornell Medical Index of 1949 [2], the Center for Building Performance at Carnegie Mellon is using the following ten indices for evaluating the importance of design, construction and operation decisions on human health:

Definition of health integral with sustainable design

1. Respiratory system
2. Digestive system
3. Eyes, vision, irritation, circadian system
4. Ears, hearing damage, concentration
5. Skin
6. Musculo-skeletal
7. Circulatory system
8. Nervous system
9. Genitourinary system
10. Mental health, stress, biophilia

Alternatively, evidence from the research suggests six primary clusters of health issues related to the built environment: respiratory (chest, wheeze, allergies, asthma, colds, flu); mucosal (eye,

nose, throat); dermal (face, hand skin); neuro-physiological (headache, migraine, dizziness, heavy-headedness); musculoskeletal; and psychological (SAD, bipolar disorder).

Linking Health and the Built Environment

By setting CBPD's definition of the attributes of sustainable design against the characteristics of human health, even intuitive judgment would illuminate the importance of building design decision making and building operation to human health, as shown in figure 1.

With over 5 years of intense study by faculty, researchers and graduate students, the Center for Building Performance and Diagnostics at Carnegie Mellon and the Advanced Building Systems Integration Consortium have been collecting building case studies as well as laboratory and simulation study results in an effort to statistically link the quality of buildings – system by system – to productivity, health and life cycle sustainability. Amassed in the BIDS™ (Building Investment Decision Support) tool, these case studies enable building decision makers to calculate returns on investments in high performance building systems, and will lead to greater understandings of the importance of land use and buildings to health (see <http://cbpd.arc.cmu.edu/ebids>).

The following six sections will explore design innovations and life cycle benefits of changes in land use, building massing and enclosure, HVAC engineering, daylight and lighting system design, interior systems, and long-term building maintenance and operations.

Sustainable Land Use and Health

One of the most significant design shifts needed for the long-term health of humans is a shift away from automobile-based land use planning and single use zoning. In industrialized nations, dramatic reductions in transportation by walking and biking may contribute to increasing rates of obesity, while increased reliance upon automobiles has resulted in ever-increasing levels of particulate and ozone that are respiratory hazards. Numerous studies have revealed the seriousness of particulate related health concerns. Wordley et al. [3] identified a 2.4% increase in respiratory admissions and a 2.1% increase in cerebro-vascular admissions associated with a 10 $\mu\text{g}/\text{m}^3$ increase PM10 in the air. According to Dockery & Pope [4] a 10 $\mu\text{g}/\text{m}^3$ increase in PM10 in the air increases respiratory admissions by 0.8 ~ 3.4%. Tenias et al. [5] found that a 10 $\mu\text{g}/\text{m}^3$ increase of NO2 and O3 in the air causes increases in the number of emergency visits for asthma by 7.6% and 6.3%, respectively.

Moreover, automobile-based design is “paving” the countryside, with the elimination of natural landscapes that act as natural lungs for our air and with salting, oils, and storm-sewer overflows resulting in toxic runoff into our drinking water. As a result, it is imperative that sustainable design ensure: live-work-walk lifestyles with mixed-use communities; multi-generational mobility with mixed mode transportation; and the preservation and celebration of natural landscapes and sustainable infrastructures.


Guidelines for Sustainable Land Use for Health

- Design live-work-walk communities to reduce car pollution – particulates and ozone – that trigger asthma
- Design for pedestrian, bicycle, transit mobility to reduce obesity
- Minimize paving for roads and parking, salting and oil runoff, as well as standing water concerns.
- Design landscape dominant environments to reduce thermal heat islands, heat stress, and rebuild nature's lungs for air quality

Sustainable building massing/ enclosure and Health

After land use design, the second most critical decision for human health may be the design of building massing and its enclosure. Humans need access to the abundances in nature - daylight, natural ventilation, thermal diversity, physical access and views; at the same time, humans need protection from natural stresses – overheating, excessive cold, rain. The design of the building enclosure is critical for both of these.

The CBPD has identified 16 international case studies linking access to the natural environment to improved health outcomes, including reductions in headaches, colds, SBS (Sick Building Syndrome), and patient length of stay (see figure 2). Beyond the health benefits, ten international case studies demonstrate that access to the natural environment increases individual productivity between 3-18% and reduce absenteeism between 9-71%, while 8 studies indicate over 50% (each) lighting and HVAC energy savings [6].

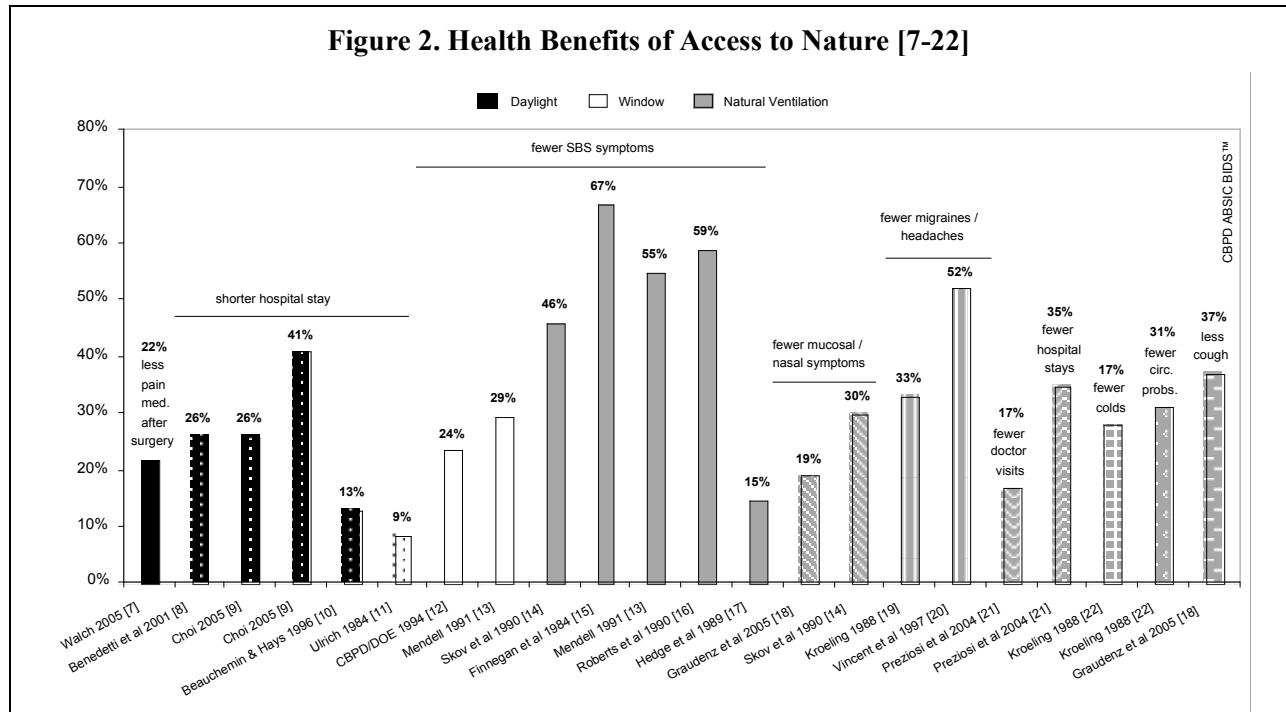

While the debate continues as to the mechanisms whereby daylight improves health, research continues to reveal that sunlight, especially morning sunlight, reduces length of stay for patients recovering from surgery, bipolar and SAD treatment [7-10]. The work of the Lighting Research Institute at RPI has begun to reveal the relationship of exposure to ultraviolet light and our melatonin production that controls circadian rhythms, sleep cycles and may even slow cancer cell development [23]. The confounding variables of glare and overheating that might accompany uncontrolled sunlight must also be studied.

The importance of views of nature and proximity to windows to human health is equally debated, with the work of Ulrich [11], Mendell [13], and now Kellert [24] identifying a link to reduced length of stay after surgery, sick building syndrome, and overall emotional health and the importance of biophilia. In addition to confirming the importance of seated views for all

building occupants, research is critically needed to understand the importance of the content of a window view to health (eg., landscape vs. sky vs. building walls), as well as the benefits of direct access to the outdoors that could accompany views through windows and doors.

The value of increasing outside air delivery rates is becoming increasingly evident, as will be described in HVAC design. It is not clear, however, whether increased levels of outside air are more effectively delivered through operable windows or through mechanical systems that incorporate filtration, dehumidification and thermal conditioning of that outside air. There are over a dozen studies that reveal the benefits of natural ventilation in existing buildings, as compared to mechanical ventilated buildings, in reduced headaches, mucosal symptoms, colds, coughs, circulatory problems, and SBS symptoms. While operable windows can bring in higher quantities of outside air, however, they can also bring in unwanted outdoor pollution, humidity, rain, and noise. The pros and cons of increasing outside air rates through natural versus mechanical means are outlined in figure 3, with a definite emphasis on the value of natural ventilation, especially given the long term field performance of HVAC systems and controls.

Figure 3. Should Windows Open?

No	Yes
Avoid outdoor pollution	Dilute indoor pollution – HVAC
Avoid outdoor humidity	Dilute indoor pollution – materials/ activities diffuse indoor humidity build up
Avoid outdoor noise (traffic, HVAC, mowers)	Connect to nature – air, sounds
Well designed/maintained HVAC provides control	Increase local ventilation rates w/o heat recovery
Avoid rain penetration	Increase local thermal control in cool periods
	Design windows to shed rain

The design implications for increasing daylight, view and natural ventilation are first to increase surface area with thinner floor plates, and second to resolve glare, overheating, heat loss, and rain penetration through appropriate enclosure design. In some respects, sustainable, healthy buildings have many of the characteristics of sustainable, healthy humans – they are physically fit rather than obese (thin floor plans, finger plans and courtyard buildings); they have circulatory systems that take the heat from the core out to the surface (eg. air flow windows); they absorb sunlight and breathe fresh air. At the same time, sustainable buildings are designed to reduce climate stresses – rain, cold and hot temperatures, diurnal temperature swings, excessive sun, freeze-thaw – with completely regional design solutions.


Guidelines for Sustainable Building Massing and Enclosure for Health

- | |
|--|
| <ul style="list-style-type: none"> ▪ Design for daylighting without glare to support visual acuity, reduce headaches ▪ Design for natural ventilation without drafts and rain penetration to reduce respiratory/flu symptoms ▪ Engineer thermal load balancing to eliminate radiant asymmetry - arthritis, circulatory disorders, ▪ Design for passive solar heating where climate appropriate for thermal comfort and UV benefits ▪ Design enclosure integrity to eliminate mold affecting SBS, respiratory/allergy and asthma |
|--|

Sustainable HVAC and Health

The design of heating, ventilation and air conditioning systems for human health are based on at least three improvements in individual occupant conditions: increased outside air rates and filtration; improved moisture/humidity control; and improved thermal comfort control.

Healthy, sustainable air, for example, is dependent on a commitment to improving the quality and quantity of outside air. Increasing outside ventilation rates has substantial research justification: a doubling or tripling of code requirements for outside air measurably reduces headaches, colds, flus, nasal symptoms, coughs, and SBS symptoms [26-35]. This may be achieved by maximizing natural ventilation with mixed-mode HVAC systems, and/or designing the HVAC system with separate ventilation air and thermal conditioning systems (thermal conditioning can be water or air based). To ensure ventilation effectiveness, the ventilation system must be designed to provide air to the individual with task air systems with some level of individual control to address local pollutant buildup. At the same time, a healthy HVAC system will guarantee pollution source control through design configuration and maintenance and for effective filtration. Beyond the studies of natural ventilation/mixed mode conditioning previously discussed, the CBPD has identified seven international case studies demonstrating that high performance ventilation strategies reduce respiratory illnesses including asthma and allergies by 10-90%, as well as ten studies that demonstrate reductions in SBS, headaches, flus and colds (see figure 4). Specifically, the critical HVAC improvements are increasing outside air rates, mold/moisture control, air stream management and filtration. In addition to health benefits, thirteen studies also suggest individual productivity gains of 1.7-11% due to high performance ventilation strategies, with a small energy penalty for increasing outside air rates with heat recovery, or 50-80% energy savings for natural ventilation combined with mixed mode conditioning [25].

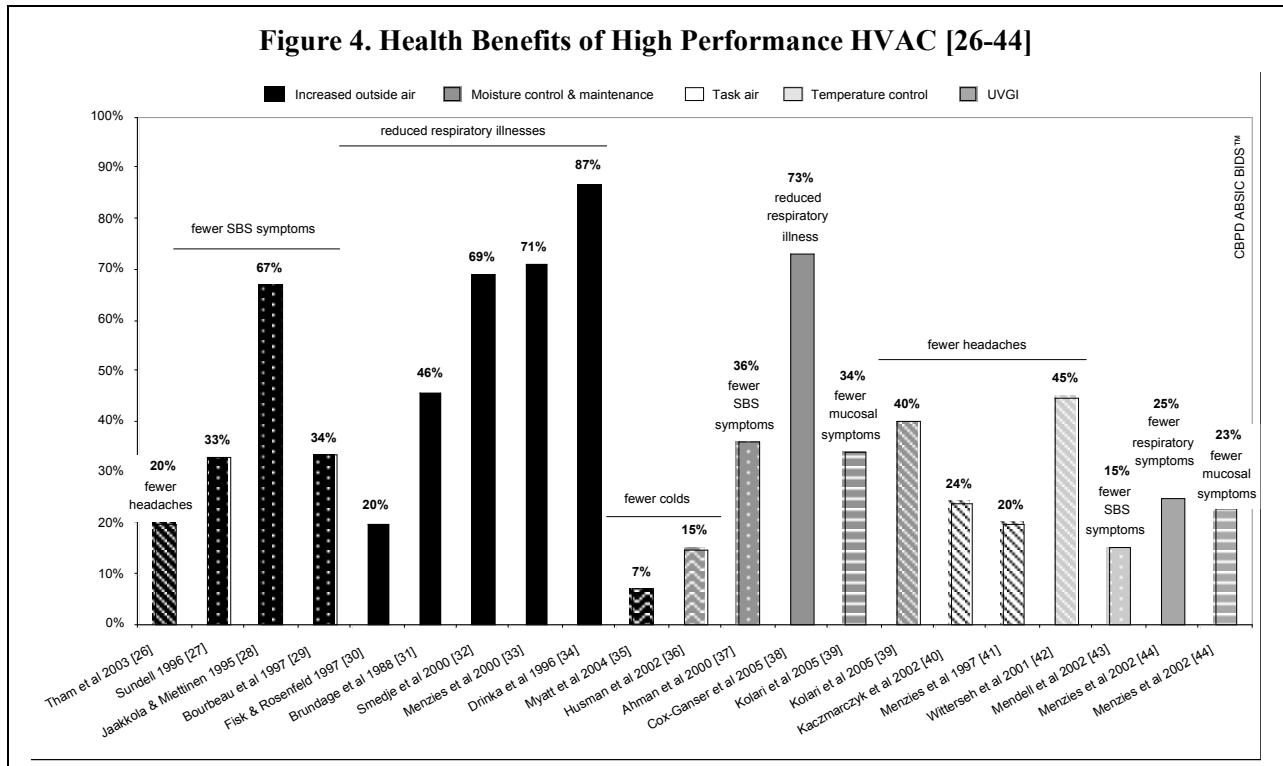

In addition to providing healthy breathing air, it is critical for the HVAC system to provide individual thermal controls. While a majority of laboratory and field experiments in this arena relate to productivity and task performance, the CBPD has identified two international case studies that link thermal comfort to reduced headache and SBS symptoms [40, 41]. Clearly,

extreme temperatures have measurable health consequences such as heat stroke and frost bite, but it is unclear whether long term exposure to moderately warm or cold thermal conditions have any health impacts. The health consequences of radiant asymmetry (the literal cold shoulder) and conductive losses through the feet to uninsulated floors, should be quantifiable, but no studies have been identified. However, the CBPD has identified 14 studies that link temperature control to individual productivity gains between 0.2-7%, while one study identified 15% percent savings in energy through task thermal conditioning, given consistent vacancy rates in office environments [45]. The challenges for HVAC design for thermal comfort are to: design for dynamic thermal zone sizes (changing use patterns); provide individual thermal controls (eg under floor air distribution system); design for building load balancing and radiant comfort; and finally, to engineer prototyped, robust systems that provide air quality and thermal comfort consistently as installed in the field, over time.

Sustainable HVAC for Health

- Increase outside air rates, through natural ventilation or HVAC with heat recovery – to reduce respiratory, allergy, asthma, colds, headaches, SBS
- Engineer ventilation effectiveness, including air path and filtration management – to reduce respiratory, throat and mucosal symptoms
- Engineer moisture/humidity management - to reduce mold affecting respiratory illnesses, colds, SBS
- Separate ventilation and thermal conditioning systems for individual thermal control – to reduce headaches and SBS symptoms


Sustainable Lighting and Health

Light levels and the control of glare and brightness contrast can dramatically impact performance at task. These variables can also impact health, with the most frequent symptoms being vision related headaches. In addition, the spectral distribution of the light source, as well as time of day variations in light, may have a measurable impact on circadian rhythms, as previously discussed. Finally, views that may be associated with daylight sources may have a measurable impact on depression, recovery rates, and SBS symptoms.

The CBPD argues for maximizing the use of daylight for both sustainability and health, so long as it can be provided without glare and excessive heat loss or heat gain. Daylight can provide the higher light levels needed for fine work, improve color rendition and sculptural definition, give the full spectrum and ultraviolet content that might be critical to circadian rhythms, and provide access to views of nature.

Electric lighting systems then have the responsibility to interface effectively with daylight to meet the needs of specific tasks, and provide the appropriate quantity and quality of light when daylight is not available. To this end, sustainable lighting is dependent on selecting the highest quality lighting quality fixtures, lamps, ballasts, reflectors, lenses and controls to light each specific task or task surface. These actions can also have health benefits. For example, replacing magnetic ballasts, with both audible buzzing and PCBs, with electronic ballasts in fluorescent lamps has resulted in a 74% reduction in the incidence of headaches in a study by Wilkins et al [47]. The separation of task and ambient lighting, to enable lower overall ambient light levels at 20-30 fc (supportive of computer work and face to face discussions) to be augmented by higher task light levels at 50-100fc (for fine print work), has resulted in 19% reduction in headaches in a study by Cakir and Cakir [48]. A third study revealed the benefits of

reducing direct and reflected glare and shadowing that can occur with direct ‘downlighting’ from the ceiling: a 27% reduction in headaches resulting from a shift to indirect/direct lighting [46].

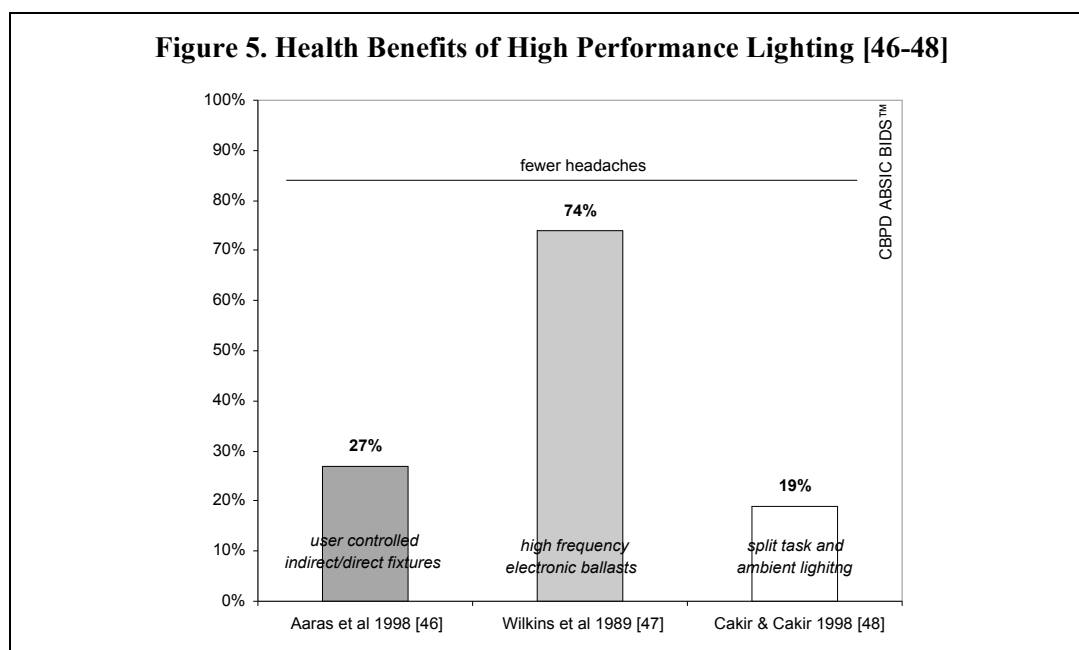

In addition to these three international case studies that demonstrate that improved lighting design reduces headache symptoms, the CBPD has identified twelve international case studies that indicate that improved lighting design increases individual productivity between 0.7-23% while reducing annual energy loads by 27-88% [49].

Guidelines for Sustainable Lighting for Health


- Design for daylighting without glare to support visual acuity, color rendition, circadian rhythms, view content – reduced length of stay, headaches
- Specify high performance fixtures for maximum lumens/watt, reduced glare, shadowing and noise - reduce headaches
- Separate ambient and task lighting delivery to match light levels to task, provide control

Sustainable Interior Systems and Health: materials and ergonomics

Among a range of interior design decisions that affect sustainability and productivity, at least two design decisions also have measurable health impacts – material selection and the ergonomics of furniture and space layout.

Interior material selection is critical in relation to thermal performance, air quality (outgassing), toxicity in fires, cancer causing fibers, and mold growth, which in turn impact respiratory and digestive systems, eyes and skin. The CBPD has identified six studies linking materials selection to health outcomes including SBS, mucosal irritation, allergies and asthma (see figure 6). While sustainable design depends on the use of materials and assemblies that support healthy indoor environments, it also mandates the selection of materials with low embodied and transportation energy, since these environmental costs carry secondary health concerns.

Figure 6. Health Benefits of High Quality Interior Materials [50-55]

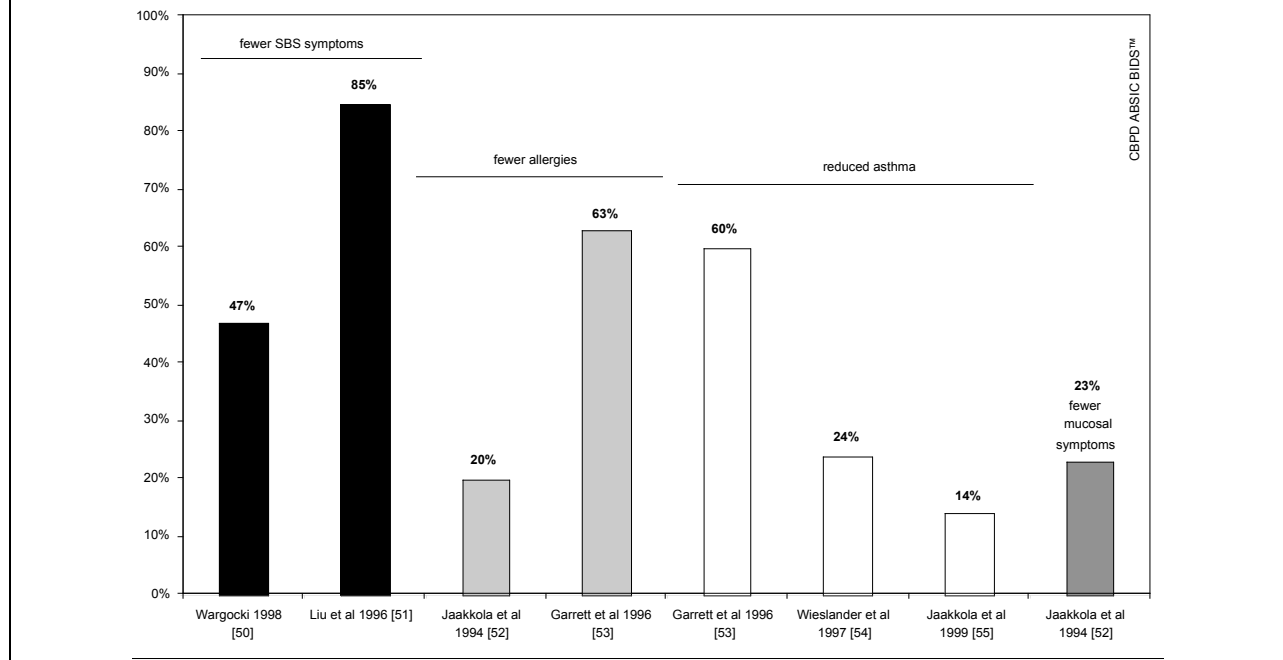


Guidelines for Sustainable Material Selection for Health

- Specify materials that do not irritate the skin with contact to avoid dermatological conditions
- Specify materials that do not outgas toxins to avoid respiratory/allergy and asthma
- Specify materials that do not degenerate into respirable fibers or emit radon to avoid cancers
- Specify materials that are not fire hazards causing respiratory illness or death
- Specify materials that do not foster mold or mildew leading to respiratory symptoms
- Specify materials with low embodied energy and low transportation costs to reduce outdoor air pollution

In addition to indoor surface materials, design decisionmakers must address the anthropometric and ergonomic needs of building occupants. Given the growing preponderance of computer-based work today, work surfaces, chairs, keyboards and mouse design must be ergonomically designed to reduce musculoskeletal disorders (MSD). According to a Washington State study, 1.7 to 3.2% of MSD complaints result in medical costs averaging \$22,000 per affected occupant, and in many cases permanent consequences for the employee [56]. The CBPD has identified 7 international case studies that demonstrate that ergonomic workstations reduce MSD symptoms between 48 – 84% (figure 7). Ergonomic design goes beyond anthropometric concerns, however, to also address building layout and densities that support human health and productivity. Seneviratne and Phoon [57] identified over 40% reductions in nose, throat and mouth symptoms with greater workspace and improved maintenance. Jaakkola and Heinonen [58] identified a 35% lower rate of colds among occupants of individual offices, compared to those in shared offices. Hendrich et al [59] identified a 70% reduction in medication errors and a 60% reduction in patient falls through the design of acuity adaptable hospital rooms.

Figure 7. Musculoskeletal Disorder Reductions due to Ergonomic Improvements [60-66]

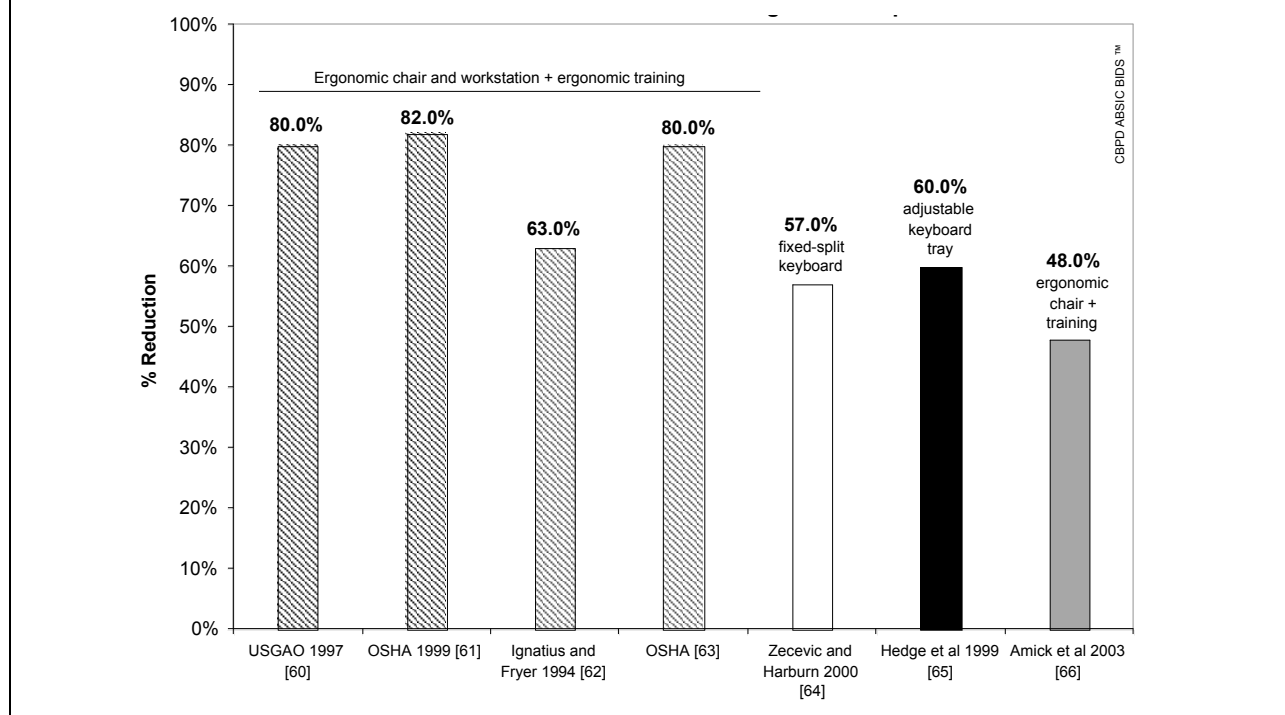

The most substantive body of research, as captured in the work of John Templer [67], may be the effective design of stairs, ramps, curbs and surfaces to reduce the frequency of falls, with measurable health consequences. The most rapidly emerging body of research may be related to the infections transferred by contact with door handles, faucets, even elevator buttons, and the importance of hands-free design and frequent hand washing. Each of these studies emphasizes the importance of space layout, finishes and furnishings to human health.

Guidelines for Sustainable Interior Design and Furnishings for Health

- Specify furniture ergonomics to reduce musculoskeletal disorders (MSD)
- Design spatial layout/density to reduce transmission of contagious illnesses (flus, colds)
- Design spatial layout to reduce falls, tripping
- Design layout and specify surfaces to reduce infections transferred by contact with hands free design

Sustainable Maintenance and Operations and Health


Needless to say, each of these design decisions will become obsolete if there is no commitment to long-term maintenance and operational standards. The building enclosure, HVAC and lighting systems must be continuously commissioned to maintain the healthy conditions intended. Standing water, dampness and mold must be prevented. Occupant densities must be managed, and furniture and finishes must continue to meet the health standards set.

In addition, human activities in buildings and the products they bring in must also be selected for health. Art supplies, cleaning supplies, plants, fertilizers and herbicides must all be environmentally benign. In addition, the food and water quality should be monitored for health, including guidelines for vending machines. Waste should also be effectively managed since it is

a natural breeding ground for roaches, rodents and other pests. While this research team has not evaluated the studies that may link poor maintenance and operation practices to health concerns, it is clear that any degradation in as-built performance will result in health consequences equally serious as those of poor design, engineering and construction.

Calculating the Life Cycle Benefits of Sustainable Design and Health

The work of the faculty, researchers and graduate students of the Center for Building Performance and Diagnostics at Carnegie Mellon and the Advanced Building Systems Integration Consortium extends beyond the pursuit of building case studies that link the quality of buildings to productivity, health and life cycle sustainability. The development of the BIDS™ tool has necessitated the identification of “soft” and hard life cycle costs in building ownership in order to calculate the return on investment of high performance building systems (see <http://cbpd.arc.cmu.edu/ebids>). Figure 8 helps to reveal the diverse building-related costs of doing business in US offices, including salaries and health benefits, technological and spatial churn, rent, energy and maintenance costs. This cost is normalized in dollars per person per year, rather than cost per square foot, since the employee represents both the greatest cost and the greatest asset to an organization.

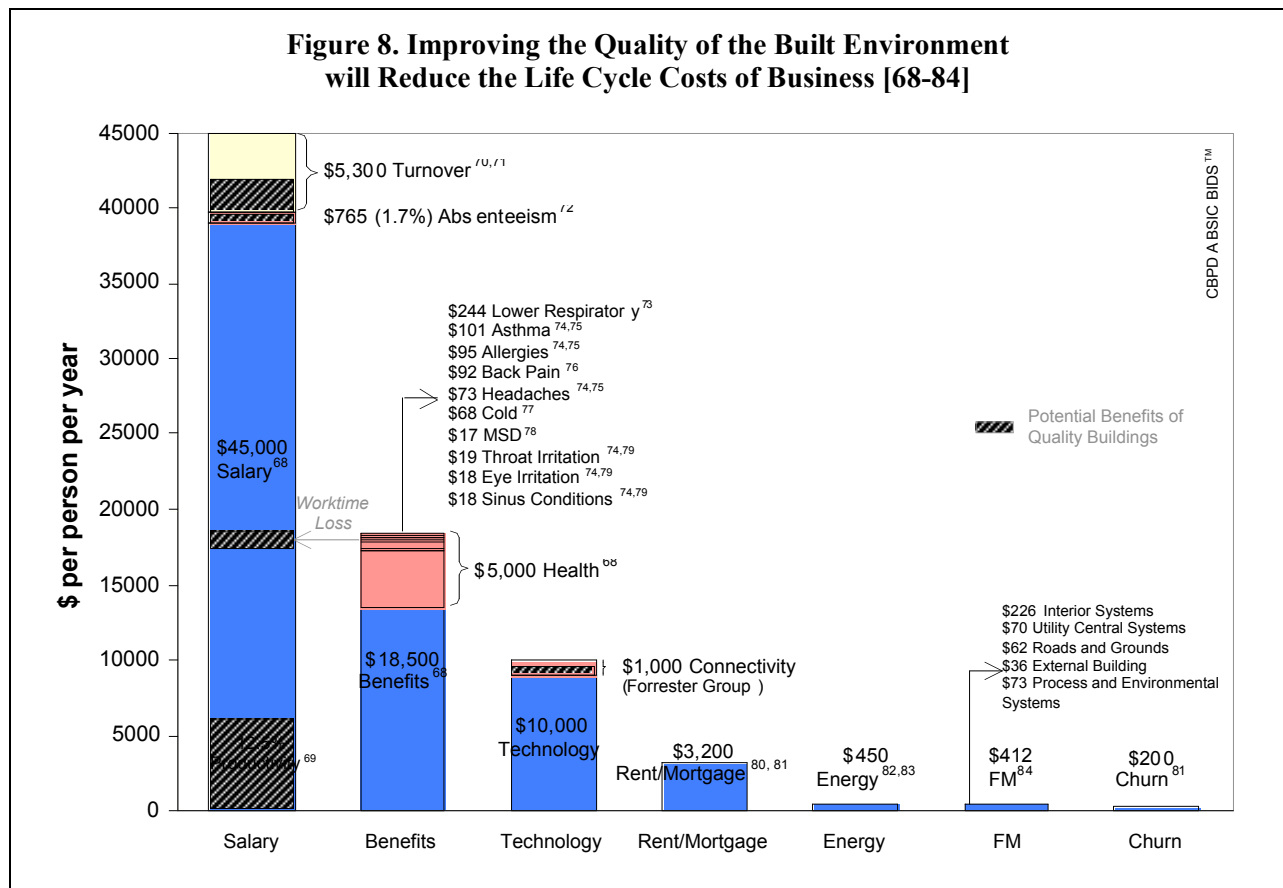

According to independent non-profit organizations, human resource research firms, and the U.S. government, the average employer cost for health insurance was approximately \$5,000 per employee per year in 2003 [85-89]. The CBPD has been able to identify the cost of several specific health conditions and illnesses that can be linked to the quality of the indoor environment, including colds, headaches, respiratory illnesses, musculoskeletal disorders, back pain (see figure 8), which account for roughly \$750 of the \$5000 annually spent per employee, or 14% of all annual health insurance expenditures. These direct costs for medical attention and pharmaceuticals would be multiplied with the indirect costs of reduced speed and accuracy on task, lost work time and absenteeism, among other secondary consequences of health concerns.

While the focus of the BIDS™ effort to date has been to improve the quality of workplaces in office buildings, there is growing interest in identifying case studies for other facility types, such as schools and hospitals. This inclusion broadens the opportunity to find case studies linking building quality to performance outcome, but requires research to customize the life-cycle factors and calculations to that building type, and to develop new design recommendations that might emerge from these data sets.

Example Measures of Cost-Benefit Performance for Different Building Types


Offices	Schools	Hospitals
O&M, Energy & Water Worker Health	O&M, Energy & Water Teacher Health Student Health	O&M, Energy & Water Length of Stay/Recovery Rates Nosocomial Infections Patient Falls Staff Health Staff Turnover
Attraction-Retention Individual Productivity	Teacher Turnover Student Test Scores College Placement	Staff Turnover
Absenteeism/Presenteeism Organizational Productivity Market Share/ Customer Speed to Market Waste Cost/Benefits Litigation/Insurance/Tax SBS	Absenteeism/Presenteeism Drop-out rates No Child Left Behind Waste Cost/Benefits	Absenteeism/Presenteeism Bed Vacancies Cost/Bed Profit/Bed Waste Cost/Benefits Medication Errors

For example, the calculation of life cycle benefits of better design, engineering and management of hospitals would include variables such as: the average length of stay per illness, averaged at 4.6 days per patient in US hospitals [90]; average cost of hospital stay, set at \$1217 per day in US hospitals [91]; patient reinfection rates, estimated at 2.16/10,000 patient days in US hospitals [92]; average of cost of these nosocomial infections, estimated at \$27,000 plus 12 day increase in hospital stay [93]; and the average cost of nurse turnover, at \$13,800 per nurse per year [94-96]. The magnitude of these costs would clearly justify significant investment and reinvestment in the quality of buildings to ensure long-term health and productivity.

Health and the Built Environment: A major research Mandate

Sustainability is in truth all about health. Energy/material extraction and use and atmospheric, water and land pollution are as significantly health-related issues as they are environmental conservation issues. Certainly the design and maintenance of building enclosures, HVAC,

lighting, and interior systems are directly linked to our short and long term health, as the evidence collected in this paper has begun to prove. Human health in the built environment is one of the most critically needed research efforts, requiring both extensive experimental and field research efforts. Controlled laboratory experiments need to be carried out simultaneously with experiments in the field – to map chains of consequence, and identify possibly building related causes for respiratory, digestive, circadian, musculo-skeletal, circulatory, and nervous system illnesses, as well as other health related concerns. Yet in the United States, at least, there is remarkably little federal investment in defining and valuing healthy buildings and communities (see figure 9).

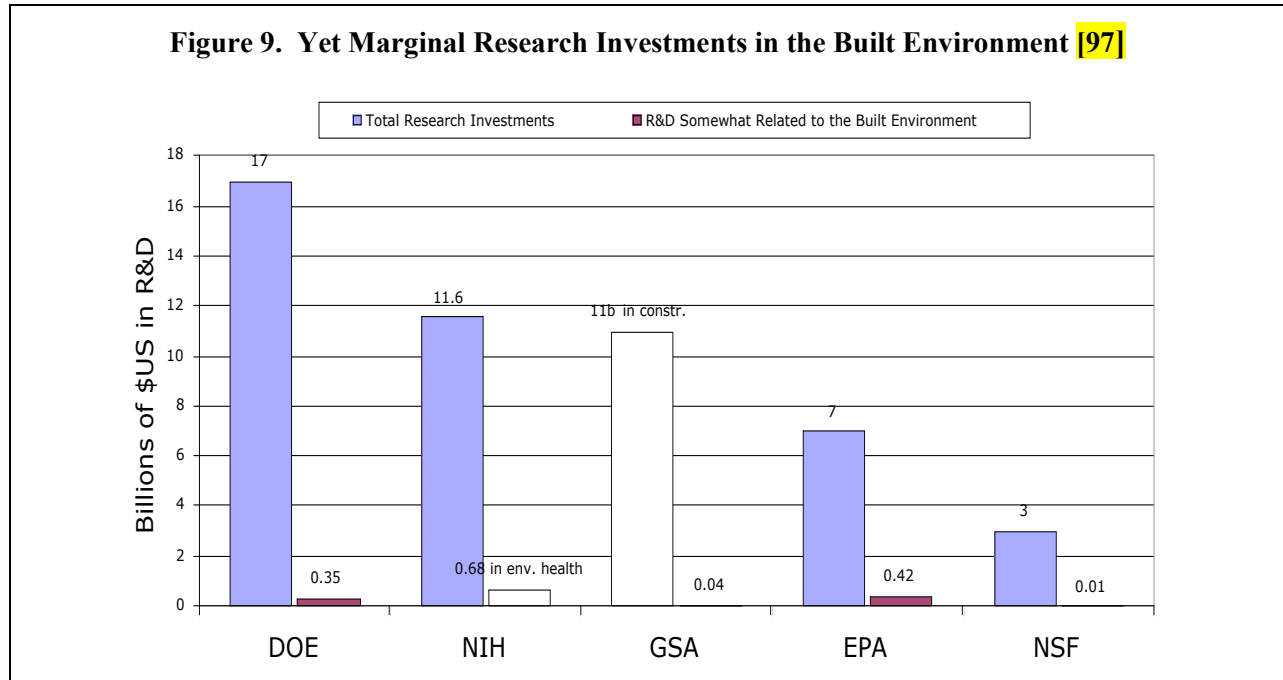

One cannot overstate the importance of defining key national and international research directions for addressing the impact of the built environment on health. Bringing together emerging knowledge about the importance of land use, building enclosure, HVAC, lighting and interior design decisions, with the life cycle justifications to ensure their implementation, is critically needed. Sustainable buildings and communities have the potential to deliver the highest quality air, thermal control, light, ergonomics and acoustic quality, as well as regionally appropriate access to the natural environment, which are integral to human health.

References

1. Loftness, V. et al (2005) "Building Investment Decision Support (BIDS™) —Cost-Benefit Tool to Promote High Performance Components, Flexible Infrastructures & Systems Integration for Sustainable Commercial Buildings and Productive Organizations," 2005 AIA Pilot Report on University Research, pp. 12-31.
2. Weill Cornell Medical Library, "A Brief History of the Cornell Medical Index" <http://library.med.cornell.edu/Library/HTML/cmi.html>
3. Wordley, J, Walters, S. & Ayres, J.G. (1997) Short term variations in hospital admissions and mortality and particulate air pollution. *Occupational and Environmental Medicine*, Vol.54, 108-16.

4. Dockery, D.W. & Pope, C.A.III (1994) Acute respiratory effects of particulate air pollution. *Ann. Rev Public Health*, 15, 107-32.
5. Tenias, J. M., Ballester, F. & Rivera, M. L. (1998) Association between hospital emergency visits for asthma and air pollution in Valencia, Spain. *Occupational and Environmental Medicine*, Vol.55, 541-47.
6. Center for Building Performance and Diagnostics / Advanced Building Systems Integration Consortium (ABSIC), Carnegie Mellon University. Building Investment Decision Support (BIDS) Tool.
7. Walch, Jeffrey et al (2005) The effect of sunlight on postoperative analgesic medication use: a prospective study of patients undergoing spinal surgery. *Journal of Psychosomatic Medicine*, 67, pp. 156-163.
8. Benedetti, F. et al. (2001). Morning sunlight reduces length of hospitalization in bipolar depression, *Journal of Affective Disorders*, v.62, pp.221-223
9. Choi, Joonho. (2005). Study of the Relationship between Indoor Daylight Environments and Patient Average Length of Stay (ALOS) in Healthcare Facilities, Unpublished master's thesis, Department of Architecture, Texas A&M University. College Station, TX.
10. Beauchemin, K.M. and P. Hays. (1996) Sunny Hospital Rooms Expedite Recovery form Severe and Refractory Depression. *Journal of Affective Disorders*, v.40, pp. 49-51.
11. Ulrich, R. (1984) View Through a Window May Influence Recovery From Surgery. *Science*, 224(4647), pp.420-421.
12. CBPD / DOE (1994) Field Studies of the Major Issues Facing Existing Building Owners, Managers and Users. Department of Energy Building Studies, Center for Building Performance and Diagnostics (CBPD), Carnegie Mellon University, Pittsburgh, PA.
13. Mendell, Mark J. (1991) Risk Factors for Work-Related Symptoms in Northern California Office Workers. Unpublished doctoral dissertation, University of California.
14. Skov, P., Valbjorn, O. and Pedersen, B.V. (1990) Influence of indoor climate on the sick building syndrome in an office environment. *Scandinavian Journal of Work Environmental Health*,16, pp. 363-371.
15. Finnegan, MJ, Pickering, CAC, Burge, PS. (1984) The Sick Building Syndrome: prevalence studies. *British Medical Journal*. Vol. 289, pp.1573-1575.
16. Robertson, AS, KT Roberts, PS Burge, G Raw (1990) The effect of change in building ventilation category on sickness absence rates and the prevalence of sick building syndrome. In *Proceedings of Indoor Air '90*, Toronto, Canada, pp. 237-242.
17. Hedge, A. et al (1989) Indoor Air Quality and Health in Two Office Buildings With Different Ventilation Systems, *Environmental International*, Vol15, pp115-128.
18. Graudenz, G.S, Oliveira, C.H., Tribess, A., Mendes, Jr, C., Latorre, M. Kalil, J. (2005) Association of Air Conditioning With Respiratory Symptoms in Office Workers in Tropical Climate. *Indoor Air*, v. 15. p. 62-66.
19. Kroeling, P. (1988). Health and well-being disorders in air conditioned buildings; comparative investigations of the "building illness" syndrome. *Energy and Buildings*, 11(1-3): 277-282.
20. Vincent, D, I Annesi, B. Festy, J. Lambrozo (1997) Ventilation system, indoor air quality, and health outcomes in Parisian modern office workers. *Environmental Research*, v. 75, pp. 100-112.
21. Preziosi P., S. Czerniichow, P. Gehanno, and S. Herberg (2004) Workplace air-conditioning and health services attendance among French middle-aged women: a prospective cohort study. *International Journal of Epidemiology*, 33(5), pp.1120-1123.
22. Kroeling, P. (1988). Health and well-being disorders in air conditioned buildings; comparative investigations of the "building illness" syndrome. *Energy and Buildings*, 11(1-3): 277-282.
23. Bullough J.D., Rea M.S., Figueiro M.G. (2006) Of mice and women: Light as a circadian stimulus in breast cancer research. *Cancer Causes and Control* 17(4):375-383.
24. Kellert, Stephen (2005) *Building for Life: Designing the Human-Nature Connection*. Washington, DC: Island Press.
25. Center for Building Performance and Diagnostics / Advanced Building Systems Integration Consortium (ABSIC), Carnegie Mellon University. Building Investment Decision Support (BIDS) Tool.
26. Tham, KW, HC Willem, SC Sekhar, DP Wyon, P Wargocki, PO Fanger (2003) Temperature and ventilation effects on the work performance of office workers (study of a call center in the tropics) In *Proceedings of Healthy Buildings 2003*, December 7-11, 2003, Singapore.
27. Sundell, J. (1996) What We Know, and Don't Know, About Sick Building Syndrome. *ASHRAE Journal*, June 1996, pp. 51-57.
28. Jaakkola, J and Miettinen, P. (1995) Ventilation rates in office buildings and sick building syndrome. *Occupational and Environmental Medicine*, 94(2), pp. 709-714.

29. Bourbeau, J., C. Brisson, S. Allaire (1997) Prevalence of the sick building syndrome symptoms in office workers before and six months and three years after being exposed to a building with an improved ventilation system. *Occupational and Environmental Medicine*, v. 54, pp.49-53.
30. Fisk, W.J. and Rosenfeld, A.H. (1997) Estimates of Improved Productivity and Health from Better Indoor Environments. *Indoor Air*, 7, pp. 158-172.
31. Brundage, J.F., McNeil, R., Lednar, W.M., Smith, D. and Miller, R. (1988) Building-Associated Risk of Febrile Acute Respiratory Diseases in Army Trainees. *Journal of the American Medical Association*, 259(14), pp. 2108-2112.
32. Smedje, G and Norback, D. (2000) New ventilation systems at select schools in Sweden—Effects on Asthma and Exposure. *Archives of Environmental Health*, 35(1), pp. 18-25.
33. Menzies, D, A Fanning, L Yuan, JM Fitzgerald (2000) Hospital ventilation and risk for tuberculosis infection in Canadian Health Care Workers. *Annals of Internal Medicine*, 133(10), pp. 779-789.
34. Drinka, P, P. Krause, M. Schilling, B. Miller, P. Shult, and S. Gravenstein (1996) Report of an Outbreak: Nursing Home Architecture and Influenza-A Attack Rates. *Journal of the American Geriatrics Society*, v. 44, pp. 910-913.
35. Myatt, TA, SL Johnston, Z Zuo, M Wand, T Kebabze, S Rudnick and DK Milton (2004) Detection of Airborne Rhinovirus and Its Relation to Outdoor Air Supply in Office Environments. *American Journal of Respiratory and Critical Care Medicine*, v169, pp. 1187-1190.
36. Husman, T. Indoor Air 2002: Respiratory Infections Among Children in Moisture Damaged Schools. National Public Health Institute, Kuopio, Finland.
37. Åhman, M., Lundin, A., Musabašić, and Söderman, E. (2000) Improved Health After Intervention in a School with Moisture Problems.” *Indoor Air*. Vol 10, pp 57-62.
38. Cox-Ganser, Jean M., et al. (2005) Respiratory Morbidity in Office Workers in a Water-Damaged Building, *Environmental Health Perspectives*, vol 113, no. 4, pp 485-490.
39. Kolari, S., Heikkila-Kallio, U. Luoma, M. et al. (2005) The Effect of Duct Cleaning on Perceived Work Environment and Symptoms of Office Employees in Non-Problem Buildings. *Building and Environment* 40, pp. 1665-1674.
40. Kaczmarczyk, J., Zeng, Q., Melikov, A., and Fanger, P.O. (2002) The effect of a personalized ventilation system on perceived air quality and SBS symptoms. In *Proceedings of Indoor Air 2002*, Monterey, CA, June 30-July 5, 2002.
41. Menzies, D., Pasztor, J., Nunes, F., Leduc, J., and Chan, C.H. (1997) Effect of a new ventilation system on health and well-being of office workers. *Archives of Environmental Health*, 52:5, pp. 360-367.
42. Witterseh, T. (2001) Environmental Perception, SBS Symptoms and the Performance of Office Work under Combined Exposures to Temperature, Noise and Air Pollution. Ph.D. Thesis, Technical University of Denmark, Denmark.
43. Mendell, M.J., W.J. Fisk, M.R. Petersen, C.J. Hines, M. Dong, D. Faulkner, J.A. Deddens, A.M. Ruder, D. Sullivan, and M.F. Boeniger (2002) Indoor Particles and Symptoms among Office Workers: Results from a Double-Blind Crossover Study. *Epidemiology*, v.13, pp. 296-304.
44. Menzies, D, J Popa, J Hanley, T Rand, D Milton (2003) Effect of ultraviolet germicidal lights installed in office ventilation systems on workers' health and wellbeing: double-blind multiple crossover trial. *The Lancet*, v. 362, pp. 1785-1791.
45. Center for Building Performance and Diagnostics / Advanced Building Systems Integration Consortium (ABSIC), Carnegie Mellon University. Building Investment Decision Support (BIDS) Tool.
46. Aaras, A., Horgen, G., Bjorset, H., Ro, O., and Thorsen, M. (1998) Musculoskeletal, Visual and Psychosocial Stress in VDU Operators Before and After Multidisciplinary Ergonomic Interventions. *Applied Ergonomics*, pp. 335-354.
47. Wilkins, AJ, Nimmo-Smith, I, Slater, AI, Bedocs, L. (1989) Fluorescent lighting, headaches and eyestrain. *Lighting Research and Technology* 21(1), pp. 300-307.
48. Cakir, A.E. and Cakir, G. (1998) Light and Health: Influences of Lighting on Health and Well-being of Office and Computer Workers, Ergonomic, Berlin.
49. Center for Building Performance and Diagnostics / Advanced Building Systems Integration Consortium (ABSIC), Carnegie Mellon University. Building Investment Decision Support (BIDS) Tool.
50. Wargocki, Pawel (1998) Human Perception, Productivity, and Symptoms Related to Indoor Air Quality. Doctoral Thesis. Center for Indoor Environment and Energy, Technical University of Denmark
51. Liu, J. Z., Y. X. Tao, L.Y. Hao (1996) The Relationship between Sick Building Syndrome and Indoor Decoration. *Proceedings of the 7th International Conference on Indoor Air Quality and Climate (Indoor Air '96)*, v. 2, pp.321-324

52. Jaakkola, JJK, P Tuomaala, O Seppanen. (1994) Textile Wall Materials and Sick Building Syndrome. *Archives of Environmental Health*, 49(3), pp. 175-182.
53. Garrett, MH, MA Hooper, and BM Hooper (1996) Low levels of formaldehyde in residential homes and a correlation with asthma and allergy in children. In *Proceedings of Indoor Air 96*, vol 1.
54. Wieslander, G., D. Norback, E. Bjornsson, C. Janson, G. Boman. (1997) Asthma and the Indoor Environment: the significance of emission of formaldehyde and volatile organic compounds from newly painted surfaces. *International Archives of Occupational and Environmental Health*. v. 79, i. 2, pp.115-124.
55. Jaakkola, Jouni J. K., Leif Oie, Per Nafstad, Grete Botten, Sven Ove Samuelson, Per Magnus. Interior Surface Materials in the Home and the Development of Bronchial Obstruction in Young Children in Oslo, Norway. *American Journal of Public Health*. 1999; 89: 188-92.
56. Silverstein, B.; Vilkkari-Juntura, E.; Kalat, J. (2000) Work-related Musculoskeletal Disorders of the Neck, Back, and Upper Extremity in Washington State, 1990-1988, Technical Report Number 40-4a-2000, Safety and Health Assessment & Research for Prevention, Washington State Department of Labor and Industries.
57. Seneviratne, M., Phoon, S. (1997) Do Indoor Air Quality Remedies Cure "Sick" Buildings? *Journal Of Occupational Health & Safety Australia And New Zealand*, 13(4). pp. 381-387
58. Jaakkola, J. J.K., Heinonen, O.P., 1995, Shared office space and the risk of the common cold, *European Journal of Epidemiology*, Vol 11, pp 213-216.
59. Hendrich, A. L.; Fay, J.; Sorrells, K.; "Effects of Acuity-Adaptable Rooms on Flow of Patients and Delivery of Care", *American Journal of Critical Care*, Jan. 2004.
60. United State General Accounting Office (1997). *Worker Protection: Private Sector Ergonomics Programs Yield Positive Results*, August 1997, GAO/HEHS-97-163.
61. Occupational Safety and Health Administration, US Department of Labor (1999). Preliminary Economic Analysis and Initial Regulatory Flexibility Analysis for the Occupational Safety and Health Administration's Proposed Ergonomics Programs Standard, (Chapter III-V and Appendix III-A, Scenario No. Scenario No. OGI-14).
62. Ignatius, E. and Fryer, B. (1994) The High Cost of Keyboard Injuries. *PC World*, 12:3, pp. 45-46.
63. Occupational Safety and Health Administration, US Department of Labor. Success with Ergonomics <http://www.osha-slc.gov/SLTC/ergonomics/ergonomicreports_pub/ergonomicsuccess/kansas/in000496.html>.
64. Zecevic, A.; Miller, D. I.; Harburn, K.; (2000) An evaluation of the ergonomics of three computer keyboards. *Ergonomics*, 43:1, pp. 55-72.
65. Hedge, A.; Morimoto, S.; McCrobie, D. (1999) Effects of keyboard tray geometry on upper body posture and comfort. - *Ergonomics*, 42:10, pp. 1333-1349.
66. Amick, B., M. Robertson, K. DeRango, L. Bazzani, A. Moore, T. Rooney, R. Harrist (2003) Effect of Office Ergonomics Intervention on Reducing Musculoskeletal Symptoms. *SPINE*, 28(24), pp. 2706-2711
67. Templer, John (1995) *The Staircase: Studies of Hazards, Falls, and Safer Design*. Cambridge: MIT Press.
68. US DOL Bureau of Labor Statistics, 2004, National Compensation Survey Occupational Wages in the US / Employer Cost for Employer Compensation
69. Leaman, A. (2001) Productivity Improvement. Buildings in Value, Vol. 3, Ch. 19. Building Use Studies Ltd..
70. US DOL Bureau of Labor Statistics, 2003, Job Openings and Labor Turnover Survey
71. Fitz-Enz, J., 2000, The ROI of Human Capital: Measuring the Economic Value of Employee Performance, American Management Assoc., NY, 2000.
72. US DOL Bureau of Labor Statistics, 2003, Current Population Survey, Table 47.
73. Birnbaum, H., M. Morley, S. Leong, P. Greenberg, G. Colice (2003) Lower Respiratory Tract Infections: Impact on the Workplace. *Pharmacoconomics* 21(10), pp.749-759.
74. Office of Pollution Prevention and Toxics, U.S. EPA. *Cost of Illness Handbook*.
75. Lucas JW, Schiller JS, Benson V. (2004) *Summary health statistics for U.S. Adults: National Health Interview Survey, 2001*. National Center for Health Statistics. Vital Health Stat 10(218).
76. Anderson et al. (2002) Relative costs and effectiveness of specialist and general internist ambulatory care for patients with 2 chronic musculoskeletal conditions. *Journal of Rheumatology* 29(7), pp. 1488 – 1495.
77. Fendrick et al. (2003) The economic burden of non-influenza-related viral respiratory tract infection in the United States. *Archives of Internal Medicine* Vol.163, pp.487-494.
78. Silverstein, B.; Vilkkari-Juntura, E.; Kalat, J. (2000) Work-related Musculoskeletal Disorders of the Neck, Back, and Upper Extremity in Washington State, 1990-1988, Technical Report Number 40-4a-2000, Safety and Health Assessment & Research for Prevention, Washington State Department of Labor and Industries.
79. Apte MG and Ehrdmann CA (2002) Indoor carbon dioxide concentrations, VOCs, environmental sensitivity association with mucous membrane and lower respiratory sick building syndrome symptoms in the base study. Indoor Environment Department, Lawrence Berkeley National Laboratory. LBNL-51570.

80. GSA Office of Real Property, 2003, Real property performance results
81. International Facility Management Association (IFMA) (2002) *Research Report 23: Project Management Benchmarks*.
82. Energy Information Agency (EIA), US DOE, 1995 Commercial Building Energy Consumption Survey
83. Office of Energy Efficiency and Renewable Energy, US DOE, *Buildings Energy Databook 2003*.
84. International Facility Management Association (IFMA) (2001) *Operations and Maintenance Benchmarks*.
85. Bureau of Labor Statistics, US Department of Labor. (2002) National Compensation Survey: Occupational Wages in the United States, 2001
86. Kaiser Family Foundation and Health Research and Educational Trust. (2003) Employer Health Benefits: 2003 Annual Survey. <<http://www.kff.org/insurance/loader.cfm?url=/commonspot/security/getfile.cfm&PageID=20672>>
87. Towers Perrin HR Services. (2003) Towers Perrin 2004 Health Care Cost Survey.
88. US Chamber of Commerce Statistics and Research Center. (2003) 2003 Employee Benefits Study.
89. Deloitte & Touche. Employer Health Care Strategy Survey 2003.
90. HCUP (Healthcare Cost and Utilization Project). Agency for Healthcare Research and Quality, <http://hcup.ahrq.gov/HCUPnet.asp>
91. U.S. Census Bureau. (2003). *Statistical Abstract of the United States: 2003*(123rd edition), Washington, DC.
92. Pittet, Didier et al. (2000). Effectiveness of a hospital-wide program to improve compliance with hand hygiene, *The Lancet*, v.356, pp.1307-12.
93. SPICE (North Carolina Statewide Program for Infection Control and Epidemiology), <http://www.unc.edu/depts/spice/MRSA-VRE-Surveillance.ppt>
94. American Organization of Nurse Executives (AONE), "Acute Care Hospital Survey of RN Vacancies and Turnover Rates in 2000", January 2002.
95. Jones, CB (2004) The costs of nurse turnover. Part 1: an economic perspective. *Journal of Nursing Administration*, 34(12), pp.362-370.
96. Jones, CB (2005) The costs of nurse turnover. Part 2: application of the nursing turnover cost calculation methodology. *Journal of Nursing Administration*, 35(1), pp.41-49.
97. Office of Management and Budget (OMB) 1998.